


NOTE: BACKFILL & COMPACT BEHIND FORMS CONCURRENT WITH INSTALLATION OF POWDER INSTALLATION.

CONDENSATE PIPE TABLE		
PIPE DIA.	a.	b.
4"	6"	6"
6"	6"	6"
8"	6"	6"
10"	8"	8"

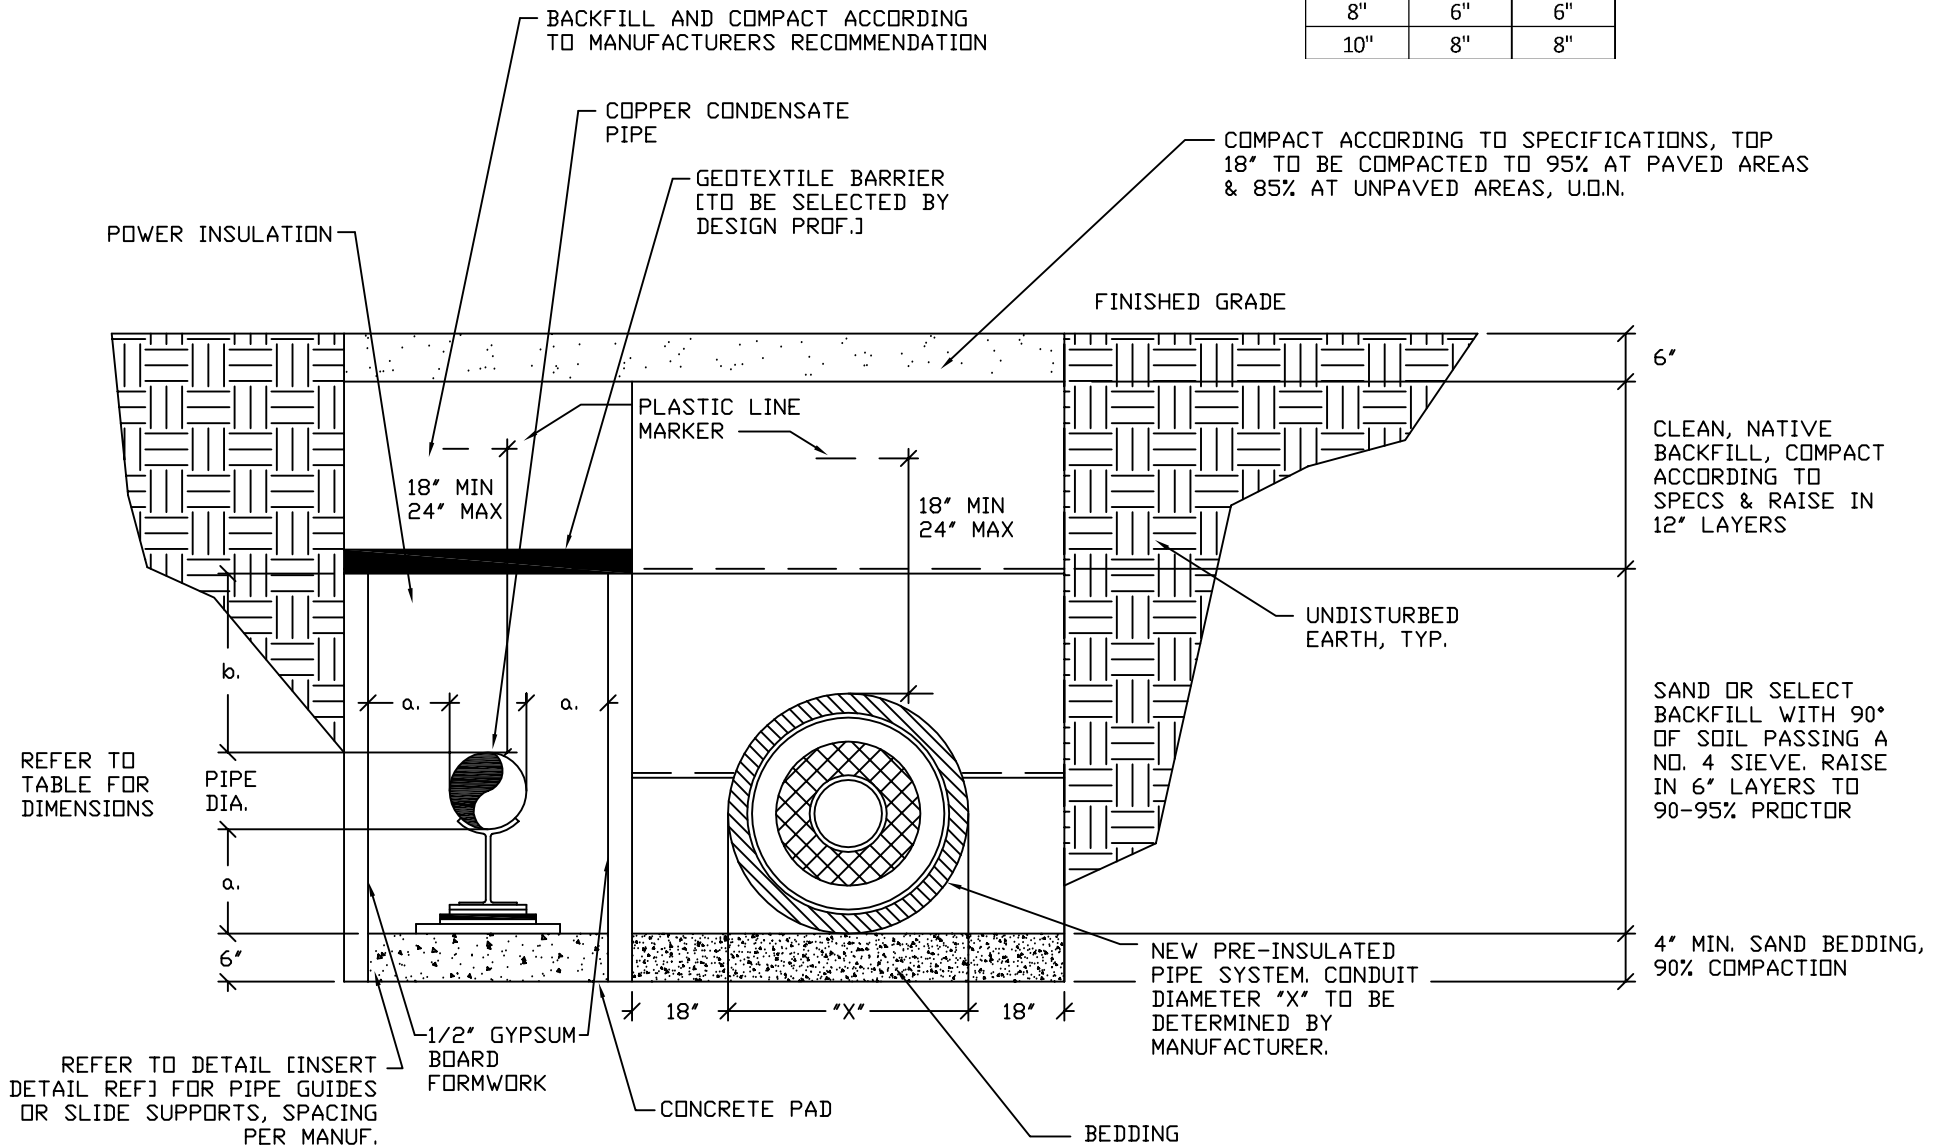

STEAM TRENCH DRAFT DETAIL

C-26.1

NTS

JULY 2016