



VALVE BOX & RISER. REFER TO DETAIL [OMNI C2 METER 3", 4", 6"]

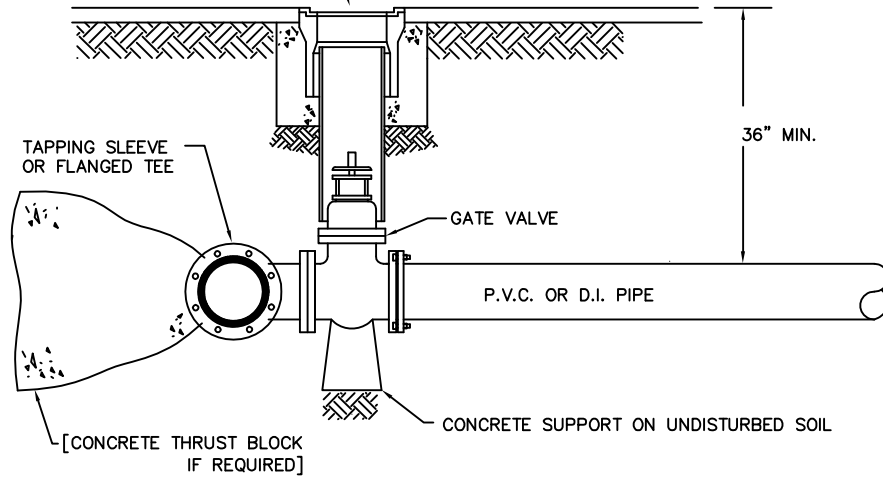

SECTION

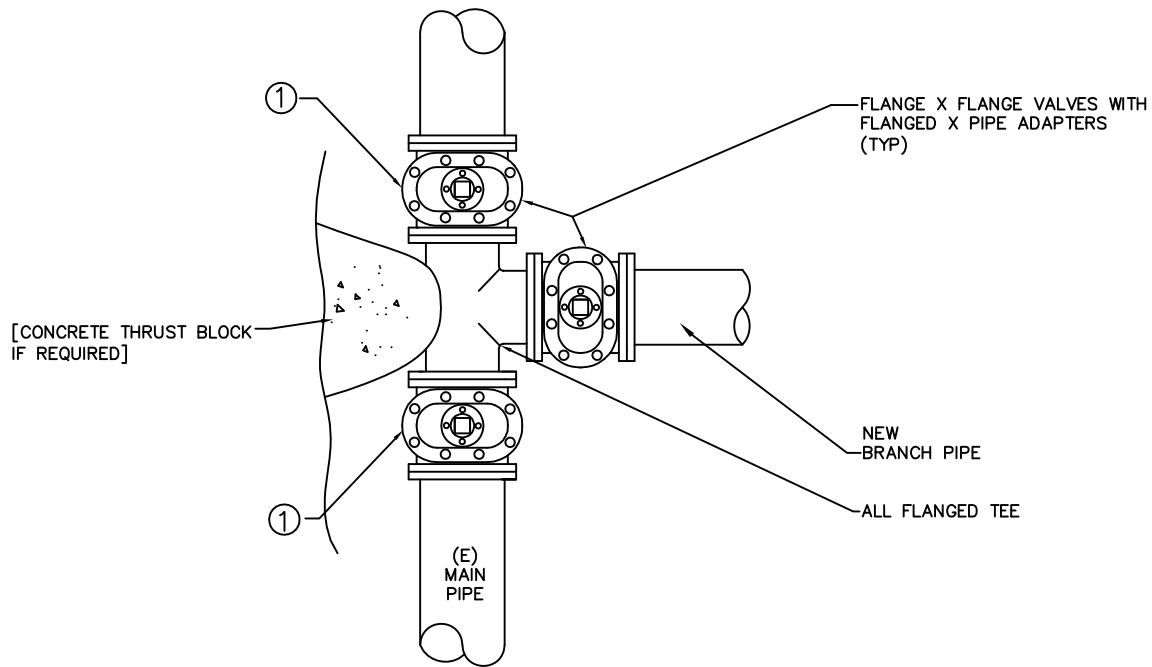

PLAN

NOTES:

1. VALVES ON MAIN PIPE ARE NOT REQUIRED AT FIRE HYDRANT

NOTES TO DESIGN PROFESSIONAL:

1. VERIFY AND EDIT TEXT IN BRACKETS [].